


### 1.1 Product Information:

Model Number		
SKU (if available)	A4/LED/3000/GIMBAL	
Type of Luminaire (for integral lamps, list base type and lamp type)	LED Luminaires	
Rated Voltage / Frequency	120Vac, 60 Hz	
Nominal Power	8W	
Rated Initial Lamp Lumen	--	
Declared CCT	3000K	
LED Manufacturer	N/A	
LED Model	N/A	
Sample Number	GZE161261-G2	
Luminaire Aperture (for downlights)	--	in.
Luminaire Length	--	mm
Luminaires Width	--	mm
Number of Units (modular products)	N/A	s

### Photo

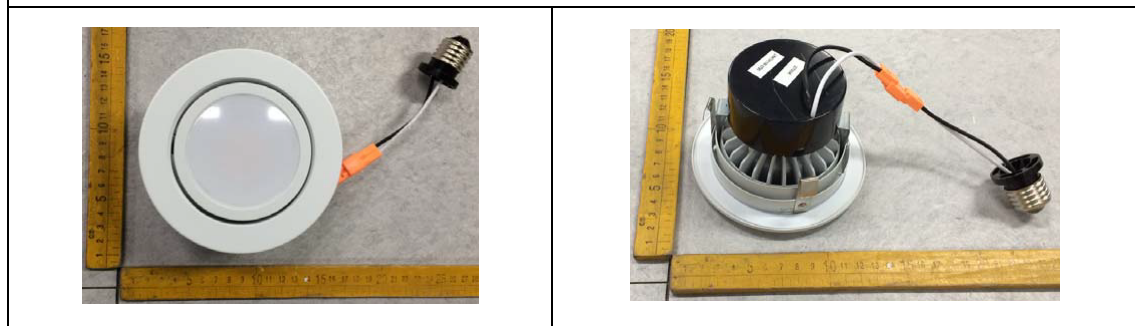

### 1.2 Test Specifications:

Date of Receipt	Dec.22,2016
Date of Test	Dec.23,2016
Test item	<ol style="list-style-type: none"> <li>1. Total Luminous Flux</li> <li>2. Luminous Efficacy</li> <li>3. Correlated Color Temperature</li> <li>4. Color Rendering Index</li> <li>5. Chromaticity Coordinate</li> <li>6. Electrical Parameters</li> </ol>
Reference Standard	<ol style="list-style-type: none"> <li>1. IES LM-79-2008 Electrical and Photometric Measurements of Solid-State Lighting Products</li> <li>2. ANSI C78.377-2008 Specifications for the Chromaticity of Solid State Lighting Products</li> <li>3. CIE 13.3-1995 Method of Measuring and Specifying Colour Rendering Properties of Light Sources</li> <li>4. CIE 15-2004 Technical Report Colorimetry</li> <li>5. IESNA LM-16-93 Practical Guide to Colorimetry of Light Source</li> <li>6. IESNA TM-16-05 Technical Memorandum on Light Emitting Diode (LED) Sources and Systems</li> </ol>

### 1.3 Test Methods

#### 1) Chromaticity Measurement – Sphere-Spectroradiometer Method:

Chromaticity parameters were measured using an integrating sphere, a spectroradiometer and software. The ambient temperature condition inside the sphere was maintained at  $25^{\circ}\text{C} \pm 1^{\circ}\text{C}$ . The sample measurements were made using a spectroradiometer connected by a fiber optic cable and detector through the detector port of the integrating sphere. The sample was operated at 120 or rated Volts AC, 60Hz. It was stabilized before measurement was made. Chromaticity coordinates, correlated color temperature and color rendering index were calculated from the spectral power distribution taken at 5 nm intervals over the range of 380 to 780 nm.

#### 2) Electrical Measurements:

Electrical parameters were measured using power meters incorporated in goniophotometer or sphere-spectroradiometer system. The ambient temperature surrounding the sample was maintained at  $25^{\circ}\text{C} \pm 1^{\circ}\text{C}$ . The sample was operated at 120 or rated Volts AC, 60Hz. It was stabilized before measurement was made. Voltage, frequency, current, power, power factor and total harmonic distortion were measured by and read from the power meter.

### 2.1 Electrical, Photometric and Chromaticity Measurements

(Refer to Work Instruction QD25)

<b>Test date</b>	2016-12-23	<b>Test Ambient:</b>	25.2 °C
<b>Test Orientation</b>	As intended	<b>Stabilization Time (min)</b>	90
<b>Model Number</b>	LRKT411W-3090		

#### Electrical Measurement:


Sample No.	Voltage (Vac)	Frequency (Hz)	Current (A)	Power (W)	Power Factor
GZE161261-G2	120.0	60	0.0703	8.370	0.9924

#### Chromaticity Measurement - Sphere-Spectroradiometer Method:

Parameter	Result
Test Voltage (V)	120.0
Frequency (Hz)	60
CCT (K)	3186
Duv	-0.0015
Chromaticity (x, y)	x=0.4224 y=0.3950
Chromaticity (u', v')	u'=0.2450 v'=0.5156
Color Rendering Index (CRI)	95.3
R9	74
Total Luminous (lm)	467.7
Luminous Efficacy (lm/W)	55.88

Special Color Rendering Indices			
R1	96	R9	74
R2	99	R10	95
R3	99	R11	95
R4	95	R12	82
R5	96	R13	97
R6	97	R14	99
R7	94	R15	94
R8	88	--	--

### Spectral Power Distribution & Chromaticity Diagram

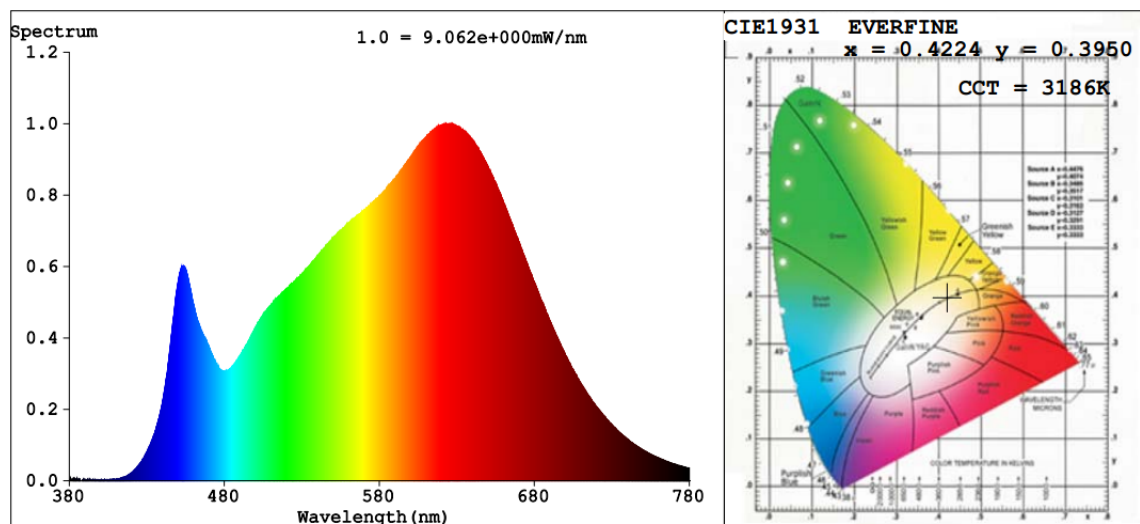

### 3. Test Equipment

Equipment ID	Equipment Name	Last Calibration Date	Next Calibration Date
ST-R-336	2 meter Integrating Sphere	2016-07-01	2017-06-30
ST-R-331	Spectral analysis system HAAS-2000	2016-07-01	2017-06-30
D204	Standard Lamp	2016-07-01	2017-06-30
PF2010	Power Meter for Integrating Sphere	2016-07-01	2017-06-30
Uncertainty: Photometric Measurement (Sphere):1.74% Chromaticity Measurement(Sphere):14.3K			